

# EDGESMITH



FOR RESIDENTIAL AND COMMERCIAL BALUSTRADES

# PS1 | MERCURY


Producer Statement  
Residential and Commercial Balustrades

The design is in compliance with the New Zealand Building Code (NZBC), NZS 3604:2011 section B1 and F4.  
Barrier loadings meet AS/NZS 1170.1:2002

Rev No. 09 | Issue Date: July 2025

# Mercury

The Mercury Balustrade Panel is made from proprietary aluminium extrusions and incorporates Edgesmith's patented system that allows the assembled panel to rake up to 30 degrees without losing rigidity. The Mercury Commercial balustrade system differs from the fence system of the same name in that it has a 50x40mm top rail. Not only does the larger section feel better under hand, it has internal stiffening webs that add a huge amount of rigidity to the panel with little extra weight. It is a panel without compromise.

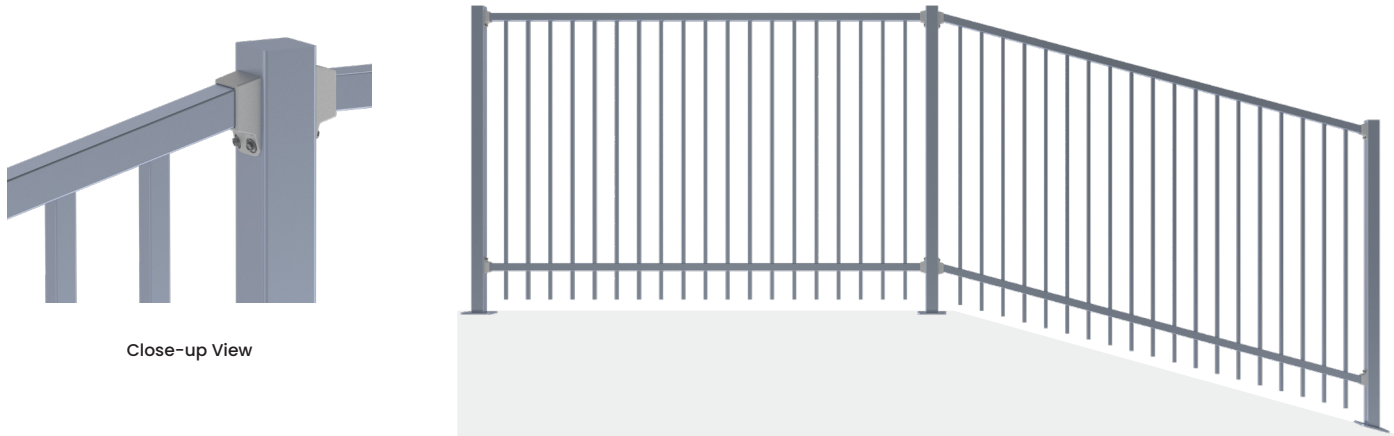

Close-up View

## Applications

The New Zealand Building Code (AS/NZS 1170.1:2002) designates different occupancy types and specifies the load ratings that the system must be capable of withstanding. The system comprises of the panel, posts, fixings and the structure that the balustrade is being attached to. These are summarised in the table below.

| Application   | Application           | Occupancy Type | Design Load | Posts Centres  | Posts   | Fixing Options      | Details |
|---|-----------------------|----------------|-------------|--|---|---------------------|---------|
| Single Dwelling Residential<br><br>Compliant Panel:<br>Mercury Residential<br>(40x40 top and bottom rails)  | Timber Retaining Wall | A              | 0.35kN/m    | 2.4m   | Alu 65SHS x 2.5 mm 6063-T5<br>Steel 65SHS x 2.5mm | Bolt or Coach Screw | Pg. 13  |
|   | In-Ground             | A              | 0.35kN/m    | 2.4m   | Alu 65SHS x 2.5 mm 6063-T5<br>Steel 65SHS x 2.5mm | N/A                 | Pg. 13  |
|   | Timber Deck           | C3             | 0.75kN/m    | 1.2m   | Alu 65SHS x 2.5 mm 6063-T5<br>Steel 65SHS x 2.5mm | Bolt or Coach Screw | Pg. 12  |
| Commercial, Parks, Schools and Single or Multi Dwelling Residential<br><br>Compliant Panel:<br>Mercury Commercial<br>(50x40 top and 40x40 bottom rails) | Timber Retaining Wall | A, B, E, C3    | 0.75kN/m    | 2.4m   | Steel 65SHS x 2.5mm                               | Bolt or Coach Screw | Pg. 10  |
|   | In-Ground             | A, B, E, C3    | 0.75kN/m    | 2.4m   | Steel 65SHS x 2.5mm                               | Concreted           | Pg. 10  |
|   | Concrete              | A, B, E, C3    | 0.75kN/m    | 1.2m or 2.4m<br><small>Refer to specific details</small> | Steel 65SHS x 2.5mm                               | Screw Bolts         | Pg. 11  |
|   | Concrete Block Wall   | A, B, E, C3    | 0.75kN/m    | 1.2m or 2.4m<br><small>Refer to specific details</small> | Steel 65SHS x 2.5mm                               | Screw Bolts         | Pg. 11  |

AS/NZS 1170.1:2002 Table 3.3 Occupancy Reference

## Table 3.3 Barrier imposed loads

| Type of occupancy for part of the building or structure                            | Specific uses   | Top Edge and Rail |               |                                   | Infill         |                  |
|--|---|-------------------|---------------|-----------------------------------|----------------|------------------|
|  |   | Horizontal kN/M   | Vertical kN/M | Inwards, outwards or downwards kN | Horizontal kPa | Any direction kN |
| A - Domestic and residential activities  | All areas within or serving exclusively one dwelling including stairs, landings etc. but excluding external balconies and edges of roofs (see C3) | 0.35              | 0.35          | 0.6                               | 0.6            | 0.25             |
|  | Other residential (see also C)  | 0.75              | 0.75          | 0.6                               | 1.0            | 0.5              |
| B, E - Offices and work areas not included elsewhere, including storage areas      | Light access stairs and gangways not more than 600mm wide   | 0.22              | 0.22          | 0.6                               | N/A            | N/A              |
|  | Fixed platforms, walkways, stairways and ladders for access (see Note 1)  | 0.35              | 0.35          | 0.6                               | N/A            | N/A              |
|  | Areas not susceptible to overcrowding in office and institutional buildings also industrial and storage buildings                                 | 0.75              | 0.75          | 0.6                               | 1.0            | 0.5              |
| C3 - Areas without obstacles for moving people and not susceptible to overcrowding | Stairs, landings, external balconies, edges of roofs etc.   | 0.75              | 0.75          | 0.6                               | 1.0            | 0.5              |

## Fasteners And Corrosion Zones

New Zealand’s coastal climate means that attention must be paid to the proximity to salt water when choosing what fasteners to use. The table below is a guide to where hot dip galvanised fasteners can be used. While it may seem counter intuitive that sheltered installations require stainless steel fittings even within 5km of the sea, it is because regular exposure to rainfall cleans the fasteners and prolongs their life.

| Environment  | Corrosion Classification | Exposed   | Sheltered   |
|--|--------------------------|---|---|
| Within 500m of breaking surf or 50m of calm salt water   | C4                       | All fixings 304 Stainless Steel                       | All fixings 304 Stainless Steel                       |
| Within 20km of salt water on West or South Coast of South Island or within 5km of salt water elsewhere       | C3                       | All fixings Hot dip Galvanised or 304 Stainless Steel | All fixings 304 Stainless Steel                       |
| More than 20km of salt water on West or South Coast of South Island or more than 5km of salt water elsewhere | C2                       | All fixings Hot dip Galvanised or 304 Stainless Steel | All fixings Hot dip Galvanised or 304 Stainless Steel |

**Note 1:** While hot dip galvanised fixings are acceptable in inland locations it is safer to use 304 grade stainless steel.


**Note 2:** The table above is only a guide. Please refer to SNZ TS 3404:2018, Figures 1 to 7 for specific corrosivity maps for further guidance.

## Inspection And Maintenance Schedule


This schedule of ongoing maintenance of structural elements shall be included with the O&M manuals and provided to the Owner/Body Corporate and building managers.

| Timeframe                              | Inspection / Maintenance   |
|--|--|
| 1/2 yearly                             | Wash down all exposed metalwork including panels, posts and fixings  |
| 10 yearly                              | Check panels, posts and fixings for signs of corrosion. Repair protective coatings or replace as required. |
| Following seismic shaking > SLS1 event | Inspect and repair as per the 10 yearly requirements.  |


**Full engineers report with design calculations available on request.**

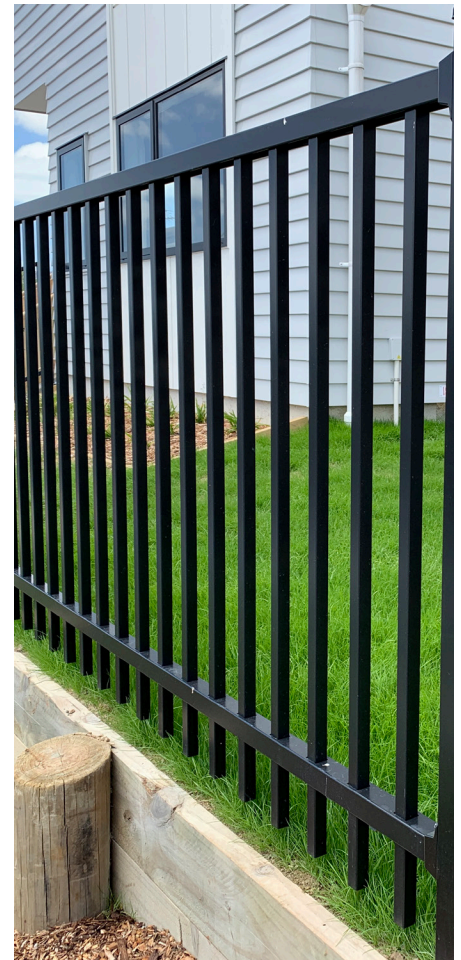


## Mercury - 1.2mH 2 Rail

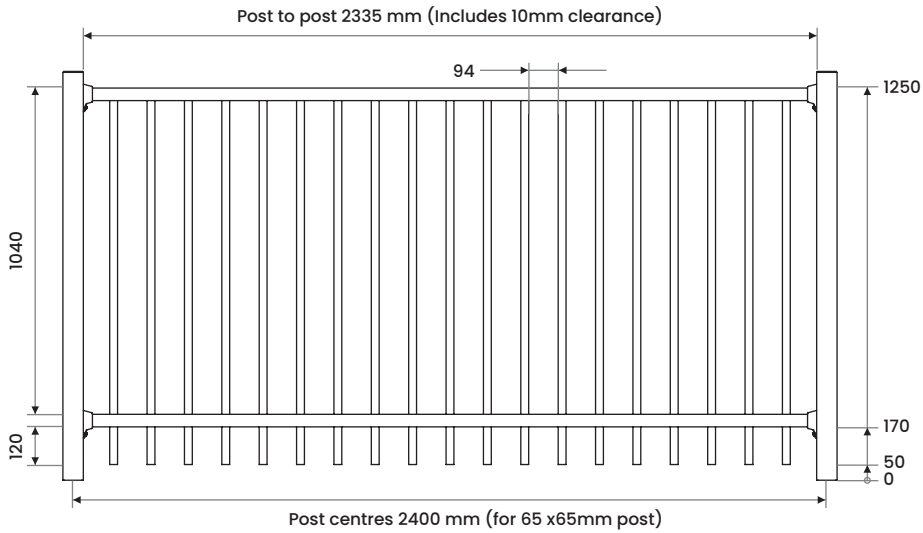

## Mercury - 1.2mH 3 Rail

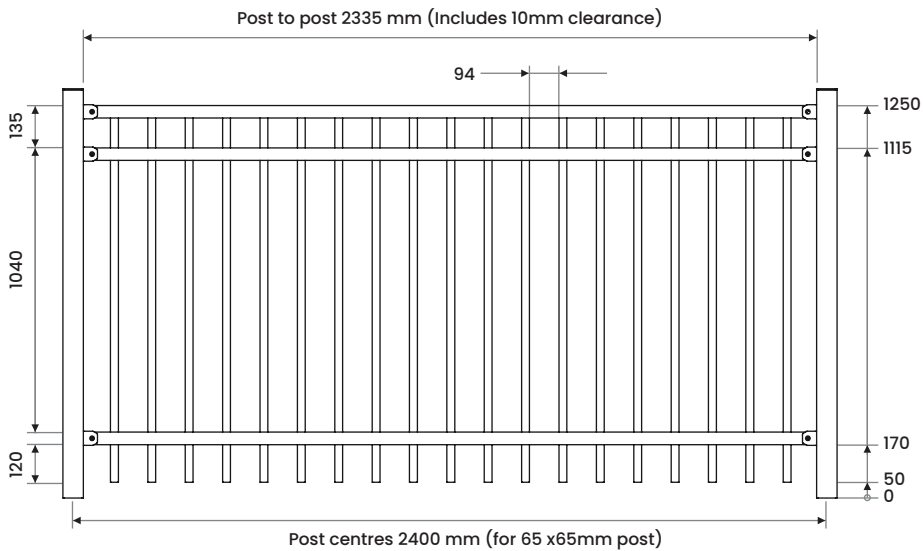

## Mercury - 1.0mH 2 Rail

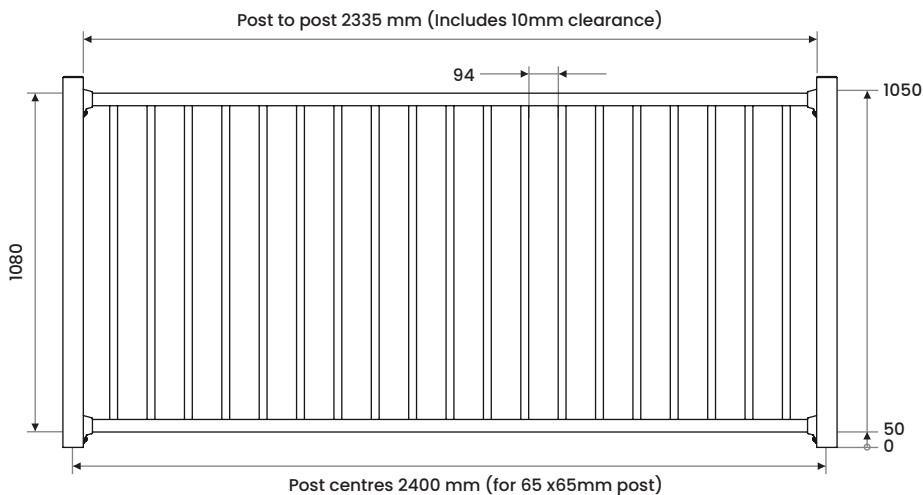

### Material:

- Aluminium
- Pickets SHS 25 x 1.2mm
- Top Rail 40 x 40 Channel (50 x 40 for Balustrade)
- Bottom Rails 40 x 40 Channel


### Finish:

- Powder Coated


### Bracket Fixings:

- Aluminium U-Brackets
- 12g Tek Screws or
- 14g Pentaforce Securit
- Tek Screws (optional)


### Bracket Details:

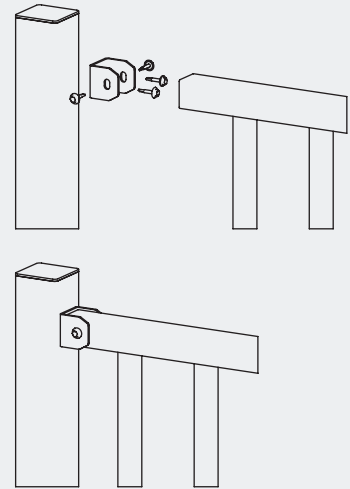

## Mercury - 1.5mH 3 Rail

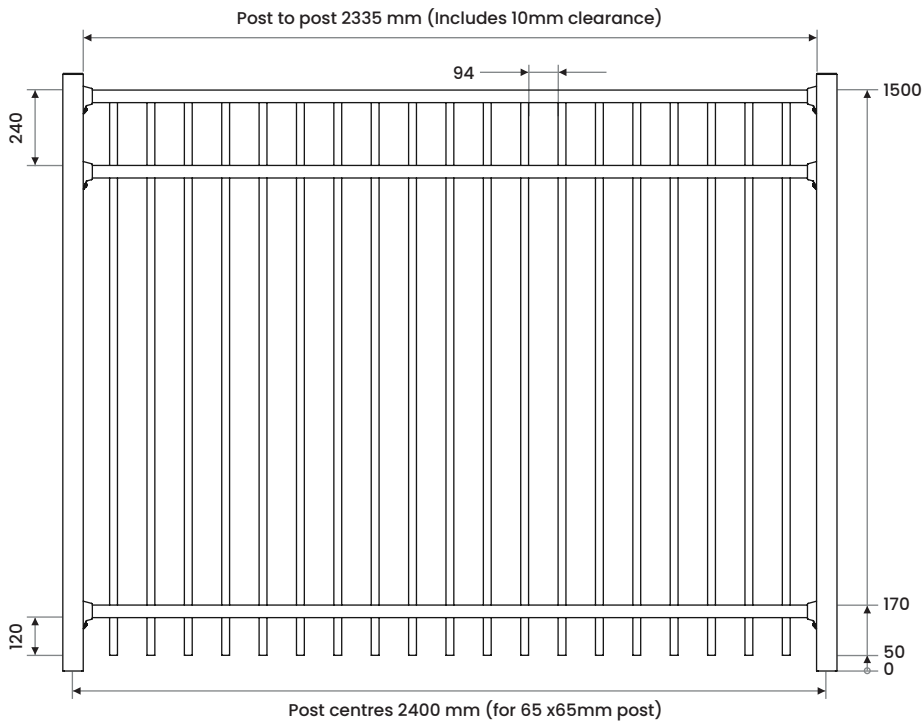

## Mercury - 1.8mH 3 Rail

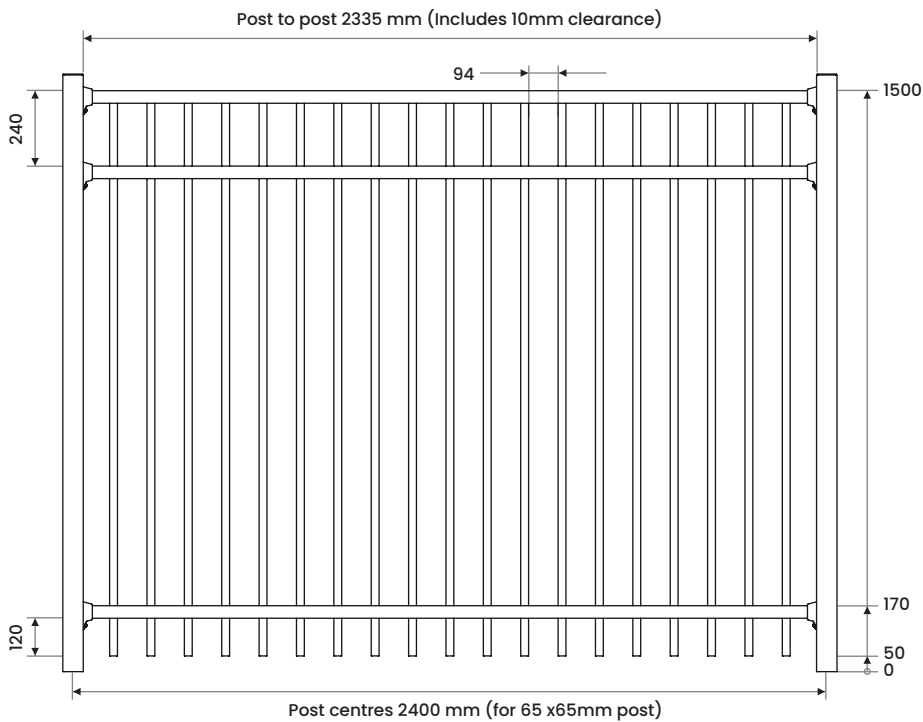

### Material:

- Aluminium
- Pickets SHS 25 x 1.2mm
- Top Rail 40 x 40 Channel (50 x 40 for Balustrade)
- Bottom Rails 40 x 40 Channel


### Finish:

- Powder Coated

### Bracket Fixings:

- Aluminium U-Brackets
- 12g Tek Screws or
- 14g Pentaforce Securit
- Tek Screws (optional)

### Bracket Details:

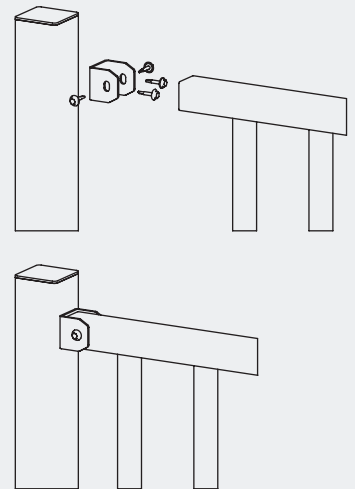



**LAUTREC**  
CONSULTING ENGINEERS



association of  
consulting and  
engineering



## PRODUCER STATEMENT – PS1 DESIGN

**BUILDING CODE CLAUSE(S):** B1, F4

**JOB NUMBER:** 2886-2411

**ISSUED BY:** Lautrec Technology Group Limited  
(Engineering Design Firm)

**TO:** Edgesmith Limited  
(Owner/Developer)

**TO BE SUPPLIED TO:** All Building Consent Authorities in NZ (Auckland Council Author Number: 1385)  
(Building Consent Authority)

**IN RESPECT OF:** Edgesmith Mercury Balustrade Systems  
(Description of Building Work)

**AT:** N/A (all locations in NZ)  
(Address, Town/City)

**LEGAL DESCRIPTION:**

N/A

We have been engaged by the owner/developer referred to above to provide (*Extent of Engagement*):

Specific Engineering Design - Structural Components Only

in respect of the requirements of the Clause(s) of the Building Code specified above for Part only , as specified in the Schedule, of the proposed building work.

The design carried out by us has been prepared in accordance with:

- Compliance documents issued by the Ministry of Business, Innovation & Employment (*Verification method/acceptable solution*) B1/VM1 and/or;
- Alternative solution as per the attached Schedule.

The proposed building work covered by this producer statement is described on the drawings specified in the Schedule, together with the specification, and other documents set out in the Schedule.

**On behalf of the Engineering Design Firm, and subject to:**

- Site verification of the following design assumptions: assumed adequate support structure by others
- All proprietary products meeting their performance specification requirements;

**I believe on reasonable grounds that:**

- the building, if constructed in accordance with the drawings, specifications, and other documents provided or listed in the Schedule, will comply with the relevant provisions of the Building Code and that;
- the persons who have undertaken the design have the necessary competency to do so.

I recommend the  level of **construction monitoring**.

I, (*Name of Engineering Design Professional*) Kevin Brown, am:

- CPEng number 140404

and hold the following qualifications BE, CMEngNZ, CPEng, IntPE(NZ), MBA

The Engineering Design Firm holds a current policy of Professional Indemnity Insurance no less than \$200,000

The Engineering Design Firm is  a member of ACE New Zealand.

**SIGNED BY** (*Name of Engineering Design Professional*): Kevin Brown  
(*Signature below*):

**ON BEHALF OF** (*Engineering Design Firm*): Lautrec Technology Group Limited

Date: 25/07/2025

**Note:** This statement has been prepared solely for the Building Consent Authority named above and shall not be relied upon by any other person or entity. Any liability in relation to this statement accrues to the Engineering Design Firm only. As a condition of reliance on this statement, the Building Consent Authority accepts that the total maximum amount of liability of any kind arising from this statement and all other statements provided to the Building Consent Authority in relation to this building work, whether in tort or otherwise, is limited to the sum of \$200,000.

This form is to accompany **Form 2 of the Building (Forms) Regulations 2004** for the application of a Building Consent.

25/07/2025

To the Building Official,

**B2 COMPLIANCE - EDGESMITH MERCURY BALUSTRADE SYSTEMS**

**at occupancy categories A, B, E, and C3 only; at any location in New Zealand that falls within the scope of this PS1 - see supporting PS1 report for scope**

We have been asked to provide a PS1 for Clause B2 of the Building Code - Structural Durability

We are not able to provide this because there is no effective verification method for B2 contained within the New Zealand Building Code.

As these systems can be installed in a variety of settings, including internal and exposed environments, it is not deemed practical to specify durability requirements for the sub structure. Timber treatments, mild steel corrosion protection coatings, and concrete and masonry covers are therefore up to the building designer to specify in accordance with the relevant recognised standards.

However, we can confirm that for the structural elements shown in the attached documentation:

| Material   | Means of compliance  | Details  |
|--|----------------------|--|
| Edgesmith Mercury Balustrade Systems - Aluminium and Steel   | Alternative Solution | Protection for mild steel has been specified in accordance with SNZ TS 3404 - Durability requirements for steel structures and components and AS/NZS 2312 - Guide to the protection of structural steel against atmospheric corrosion by the use of protective coatings.<br><br>Aluminium extrusions conform to 6063 T5.<br><br>We note that this is on a time to first maintenance basis. |
| Connections - Hot Dip Galvanised and Stainless Steel fixings | Alternative Solution | All bolt and screw fixings for the Edgesmith Mercury Balustrade Systems shall be either Hot Dip Galvanised or 304 Stainless Steel. Refer to the fixing table in the manual.  |

It is assumed that these structural elements are fixed to adequate structures by others.

Minor tea staining may occur in coastal environments. Refer to Edgesmith Mercury Balustrade Systems manual for the supplier's maintenance requirements.

Yours faithfully,

Managing Director  
Kevin Brown  
BE, CMEngNZ, CPEng, IntPE(NZ), MBA



OUTLINE OF COMPLIANCE FOR PARTICULAR ITEMS COMPRISING THE  
EDGESMITH MERCURY BALUSTRADE SYSTEMS

**Outline of compliance for particular components, NZBC B1**

|  |   |
|--|---|
| <p><b>Mild steel sections and aluminium extrusions</b></p> | <p>Refer to Appendix A3 Calculations - Edgesmith Mercury Balustrade Systems</p>   |
| <p><b>Coach screws, bolts and concrete anchors</b></p>     | <p>Refer to Appendix A3 Calculations - Edgesmith Mercury Balustrade Systems</p> <p>For fixings to timber, calculations by Lautrec outlined within Appendix A3 confirm compliance.</p> <p>For fixings to concrete, refer to Appendix A3. Concrete is assumed to be min. 20 MPa reinforced concrete (C20), uncracked, and without edge reinforcement.</p> <p>The project engineer shall review and confirm appropriate supporting structure to accommodate loads introduced by the proposed system. Refer to sections within the manual for guidance on installation, and Appendix A3 for loadings of connections back to assumed adequate structure.</p> |

**Outline of compliance for NZBC B2**

All components outlined in the product catalogue shall meet NZBC B2.3.1(b) **15 years**, assuming reasonable maintenance, and appropriate architectural context.

Refer to the Edgesmith Mercury Balustrade Systems manual for maintenance requirements.

Mild steel, Aluminium components, hot dip galvanised or stainless steel 304 fixings are fit for purpose in NZBC corrosion zones C2, C3 and C4. Refer to the product catalogue for more details.

Adequate supporting structure shall be designed by the project designers.

Durability of assumed adequate supporting structure is outside the scope of this PS1.

## GENERAL NOTES

- (1) THE BALUSTRADE DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE ARCHITECT'S AND ENGINEER'S DRAWINGS.
- (2) ALL DIMENSIONS AND LEVELS ARE TO BE CHECKED ON SITE AGAINST THE ARCHITECT'S AND ENGINEERS DRAWINGS PRIOR TO COMMENCING WORK – ANY VARIATIONS OR DISCREPANCIES ARE TO BE REFERRED TO THE CONSULTANT FOR RESOLUTION.
- (3) THE EXISTING SUPPORTING STRUCTURE DETAILS ARE NOT COVERED BY THESE DRAWINGS. IT IS ASSUMED THAT THE EXISTING SUPPORT STRUCTURE CAN ACCOMMODATE THE ADDITIONAL LOADS INDUCED BY THE BARRIER. IN ADDITION, THE EXISTING STRUCTURE MUST HAVE THE REQUIRED MINIMUM PROPERTIES AS FOLLOWS:  $f'c = 20 \text{ MPa}$  (FOR CONCRETE),  $f'm = 12 \text{ MPa}$  (FOR MASONRY), GROUP J4 OR J5 MATERIAL (FOR TIMBER).
- (4) THESE DRAWINGS ONLY COVER THE INSTALLATION/CONNECTION DETAILS OF THE MERCURY COMMERCIAL BALUSTRADE SYSTEM.
- (5) A MINIMUM OF 48 HOURS NOTICE IS REQUIRED FOR ANY CONSTRUCTION MONITORING OBSERVATIONS. A PS4 CANNOT BE PROVIDED (PRODUCER STATEMENT CONSTRUCTION REVIEW), IF THE CONSULTANT IS NOT INFORMED OF THE REQUIRED INSPECTIONS THAT THE LOCAL TERRITORIAL AUTHORITY MAY REQUIRE.
- (6) REMOVE ALL EXCESS MATERIALS AND RUBBISH FROM SITE AND REINSTATE ANY DAMAGE ON COMPLETION OF WORKS.
- (7) ALL DAMAGE TO EXISTING STRUCTURE CAUSED BY CONSTRUCTION ARE TO BE REINSTATED.
- (8) ALL WORKS ARE TO COMPLY WITH THE NEW ZEALAND BUILDING CODE (NZBC).

## DURABILITY – STEEL FIXINGS & COMPONENTS

- (9) HOT-DIPPED GALVANIZED BOLTS/FIXINGS CAN BE USED FOR LOCATIONS THAT FALL UNDER TYPICAL ATMOSPHERIC CATEGORIES B & C SO LONG AS THE MAINTENANCE PROGRAM AS DETAILED FOR THE DESIGN IS STRICTLY ADHERED TO. REFER TO TABLE 1 & 2 BELOW.
- (10) GRADE 304 STAINLESS STEEL BOLTS/FIXINGS ARE TO BE USED FOR LOCATIONS THAT FALL UNDER TYPICAL ATMOSPHERIC CATEGORY D OR IN CATEGORY C LOCATIONS WHERE ITEMS ARE DEEMED TO BE SHELTERED AND UNABLE TO BE WASHED REGULARLY AS REQUIRED BY THE MAINTENANCE PLAN. REFER TO TABLE 1 & 2 BELOW.
- (11) FOR FIXINGS REQUIRED IN AREAS OF TYPICAL ATMOSPHERIC CATEGORIES OTHER THAN B, C & D, OR IN WET LOCATIONS WHERE STEEL WILL REMAIN WET FOR EXTENDED PERIODS OF TIME, SUCH AS CREVICES, LOW POINTS & POCKETS NOT DRAINED, THESE WILL REQUIRE SPECIFIC ENGINEERING DESIGN (SED) WHERE MORE DURABLE GRADE 316 OR HIGHER STAINLESS STEEL OR SILICON BRONZE FIXINGS MAYBE MORE SUITABLE. REFER TO TABLE 1 & 2 BELOW.
- (12) FOR FIXINGS AND COMPONENTS THAT ARE TO HAVE DIRECT CONTACT WITH PRESERVED TIMBER (PT), ESPECIALLY WHEN THE PRESERVATIVE TREATMENT USES COPPER AZOLE-BASED (CuAz) OR ALKALINE COPPER QUATERNARY-BASED (ACQ) PRESERVATIVES AND A HIGH TIMBER MOISTURE CONTENT IS EXPECTED, THEN GRADE 304/316 STAINLESS STEEL FIXINGS ARE RECOMMENDED. IF GALVANIZED FIXINGS ARE USED WHERE MOISTURE CONTENT OF THE PRESERVED TIMBER (PT) WAS EXPECTED TO BE LOW BUT SUBSEQUENTLY FOUND TO BE HIGH THEN THEIR INSPECTION SHOULD BE CARRIED OUT REGULARLY AS PART OF THE MAINTENANCE PROGRAM. THIS WOULD INVOLVE REMOVING ANY HIGH-RISK COMPONENTS SUCH BOLTS OR COACH SCREWS FIXED INTO OBVIOUS DAMP AND WET TIMBERS WHICH MAY OR MAY NOT BE CLOSE TO THE GROUND OR EVEN HIGHER THAN 600MM FROM THE GROUND. THE EMBEDDED THREAD AND SHAFT NEEDS TO BE REMOVED AND INSPECTED CLOSELY AT MINIMUM 5 YEARLY INTERVALS. IF SIGNS OF CORROSION ARE FOUND ON OVER 1%-2% OF THE SURFACE AREA THEN THE FIXING IS TO BE REPLACED WITH A STAINLESS-STEEL EQUIVALENT OR A GALVANIZED BOLT WITH ADDITIONAL SURFACE PROTECTION WHILE CONTINUING THE SAME MAINTENANCE PROGRAM TO MONITOR OR UNTIL SATISFACTORY. IN SOME SPECIFIC ENGINEERING DESIGN (SED) CASES, MORE DURABLE MATERIALS SUCH AS SILICON BRONZE MAYBE REQUIRED.
- (13) PREVENT CONTACT BETWEEN ALL DISSIMILAR MATERIALS (i.e. GALVANIZED STEEL AND ALUMINIUM OR GALVANIZED STEEL AND STAINLESS STEEL) BY SEPARATING WITH NEOPRENE WASHERS OR SIMILAR APPROVED.
- (14) ALL CHEMSET CONCRETE ANCHORS ARE TO BE FIXED TO MANUFACTURER'S SPECIFICATIONS.

TABLE 1: TYPICAL ATMOSPHERIC CATEGORY

| ENVIRONMENT LIMITATIONS   | MACROCLIMATE CORROSION CATEGORY (SNZ TS 3404:2018 & AS/NZS 2312.1:2014) |
|---|---|
| MORE THAN 20KM TO 50KM FROM SALT WATER ON WEST & SOUTH COAST OF SOUTH ISLAND, 5KM TO 50KM FROM SALT WATER ON EAST COAST OF BOTH ISLANDS & SOUTH COASTS OF NORTH ISLAND & ALL HARBOURS OR OTHERWISE INLAND MORE THAN 50KM.   | C2  |
| WITHIN 20KM OF BREAKING SURF ALONG THE WEST & SOUTH COASTS OF SOUTH ISLAND, OR WITHIN 5KM OF SALT WATER ALONG EAST COAST OF BOTH ISLANDS, OR WITHIN 5KM OF SALT WATER WEST & SOUTH COASTS OF THE NORTH ISLAND, & ALL HARBOURS.  | C3  |
| WITHIN 500M INLAND OF BREAKING SURF, OR WITHIN 50M OF CALM SALT WATER SUCH AS HARBOUR FORSHORES. THIS AREA MAY BE EXTENDED INLAND BY PREVAILING WINDS AND LOCAL CONDITIONS.   | C4  |
| WITHIN 200M OF BREAKING SURF ON THE WEST AND SOUTH COASTS OF THE SOUTH ISLAND, OR WITHIN 100M OF BREAKING SURF ON THE WEST AND SOUTH COASTS OF THE NORTH ISLAND, OR WITHIN 50M OF BREAKING SURF ON ALL OTHER COASTS, OR WITHIN 500M OF GEOTHERMAL SOURCE OR WITHIN SPACES OF HIGH HUMIDITY OR CORROSIVE ENVIRONMENTS. CONTACT YOUR SUPPLIER/ENGINEER FOR MORE GUIDANCE. | SED<br>C5-I, C5-M, CX/T   |

NOTE 1: ABOVE ENVIRONMENTS MAY BE EXTENDED INLAND BY PREVAILING WINDS & LOCAL CONDITIONS.


REFER TO SNZ TS 3404:2018 FIGURES 1 TO 7 FOR SPECIFIC CORROSION MAPS FOR FURTHER GUIDANCE. FOR CONFIRMATION OF A SITE-SPECIFIC ATMOSPHERIC CORROSION CATEGORY (FOR EXAMPLE, FOR SITES THAT ARE SHELTERED FROM MARINE INFLUENCE BY THE LOCAL TOPOGRAPHY), THEN SITE-SPECIFIC TESTING CAN BE CARRIED OUT AS DESCRIBED IN HERA REPORT R4-133.

TABLE 2: DURABILITY PROVISION

| TYPICAL ATMOSPHERIC CATEGORY | C4                     | C3                          | C2                          | ALL OTHERS |
|------------------------------|------------------------|-----------------------------|-----------------------------|------------|
| EXPOSED (NOTE 2)             | ALL FIXINGS TYPE 304SS | HOT DIPPED GALVANIZED STEEL | HOT DIPPED GALVANIZED STEEL | SED        |
| SHELTERED (NOTE 2)           | ALL FIXINGS TYPE 304SS | ALL FIXINGS TYPE 304SS      | HOT DIPPED GALVANIZED STEEL | SED        |

NOTE 2: REFER TO SNZ TS 3404:2018 FOR DEFINITION OF "SHELTERED" & "EXPOSED". WHERE ITEMS ARE IN SHELTERED LOCATIONS THESE CAN BE TREATED AS EXPOSED IF REGULAR WASHING DOWN IS CARRIED OUT AS PART OF THE REGULAR MAINTENANCE PROGRAM.


## Side Fix to Timber Retaining Wall - Commercial

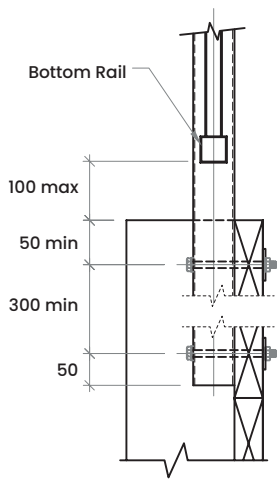

### Fixings: Bolts

2 x M10 Bolts (min.) with 50 x 50 x 5mm or 2 x 50 x 50 x 3mm sq washer on timber side.


Post: PBS-2.0-2CTR

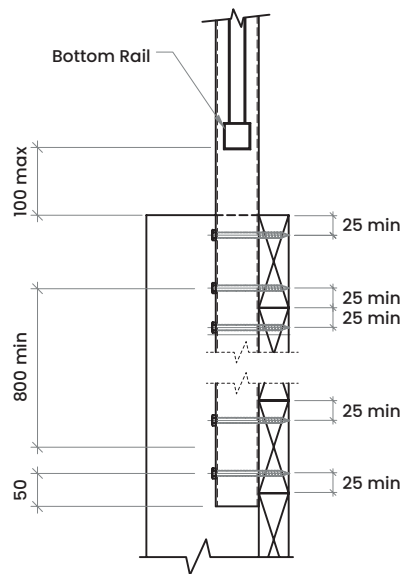

### Fixings: Coach Screws

5 x M10 Coach Screws, min 45 mm penetration into timber.

Post: PBS-2.4-5CTR-GPCB or  
PBS-2.4-5CTR-GPC

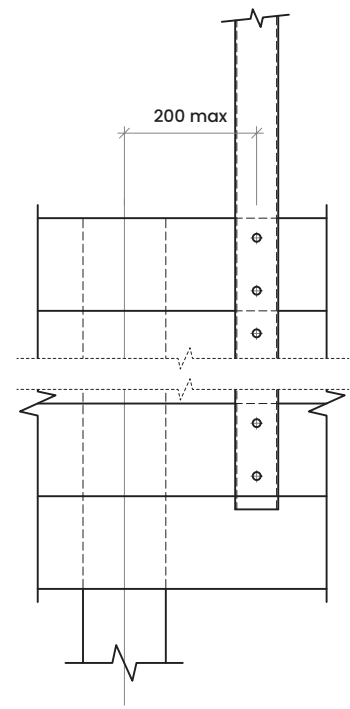

### Retaining Wall Post


## Concreted in Ground - Post Centers 2.4m

2.4m Max. Post Spacing & 1.2m Max. Height

Covers A, B, E, C3 occupancy category loading & Extra High wind zone.

### Note:


Post footing to be embedded in good ground with min 100kPa allowable bearing as defined by NZS 3604:2001

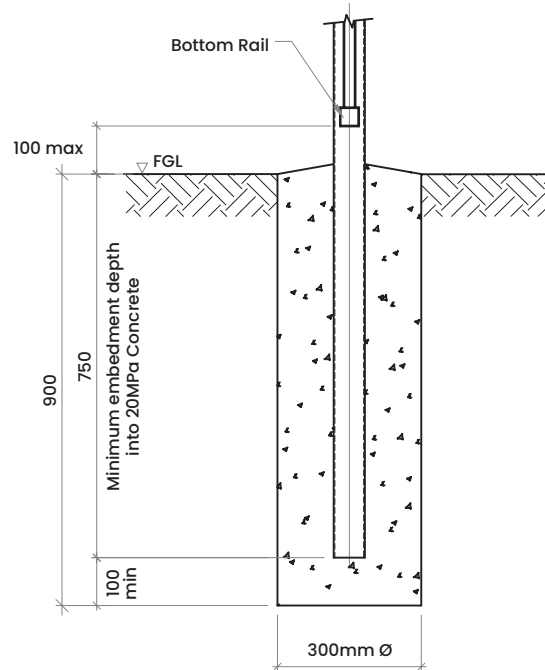

## Post Details for Balustrade - Commercial


| Zone Class   | Loading  | Panels             | Posts                                    | Fasteners  |
|--|----------|--------------------|--|--|
| B, E, C3<br>School, Park, Multi- Dwelling<br>Residential, Commercial | 0.75kN/m | Mercury Commercial | 65shs x 2.5mm Steel<br>Post centers 2.4m | <500m from sea - 304SS,<br>>500m from sea - 304SS or HDG |

## Top Fix to Concrete – Post Centers 2.4m

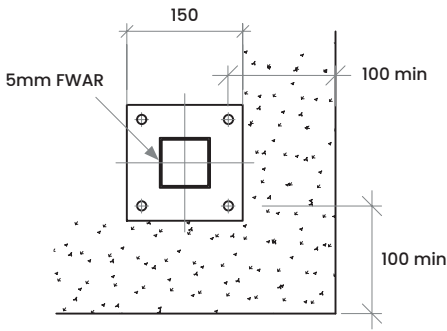


Fixings: Screw Bolts

4 x M12 Screw Bolts fischer concrete screw ULTRACUT FBS II 12x10 or equivalent, 81 mm embedment into 20 MPa uncracked concrete.

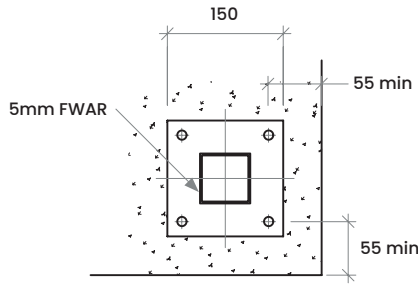


Fixings: Chemical Anchors

4 x M12 threaded rod with fischer FIS V or equivalent, 75 mm min embedment into 20 MPa uncracked concrete.

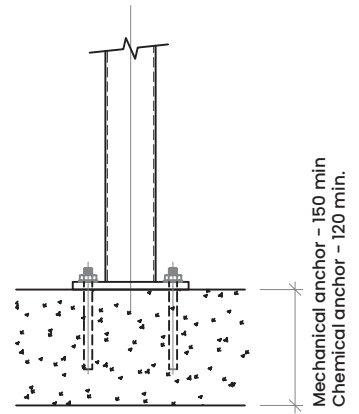


Mechanical anchor – 150 min.  
Chemical anchor – 120 min.

## Side Fix to Block Wall – Post Centers 2.4m

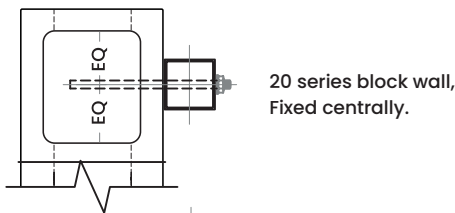

20 series block wall,  
Fixed centrally.

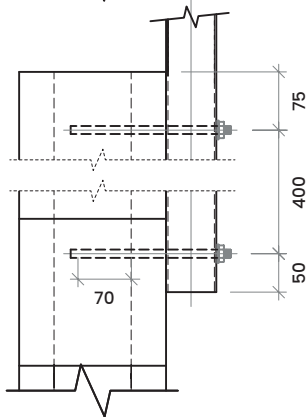


Fixings: Chemical Anchors

Post centers 2.4m

2 x M12 threaded rod with fischer FIS V or equivalent, 70mm min into masonry core, fully grouted 20 MPa. Uncracked concrete

Post: PBS-1.9-2MB-GPCB  
or PBS-1.9-2MB-GPC

## Side Fix to Concrete – Post Centers 1.2m

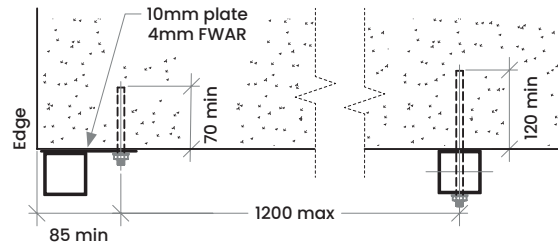


Fixings: Chemical Anchors

1.2m Max. Post Spacing

For typical/intermediate balustrade posts:  
2 x M12 threaded rod with fischer FIS V or equivalent, 120 mm min. anchorage depth into 20 MPa concrete.


For end balustrade posts:  
2 x M12 threaded rod with fischer FIS V or equivalent, 70 mm min. anchorage depth into 20 MPa uncracked concrete ensure 85 mm min. side edge distance.

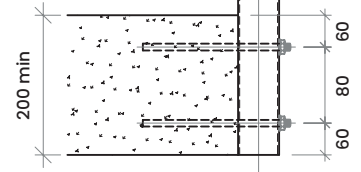

## Top Fix to Block Wall – Post Centers 1.2m

Fixings: Chemical Anchors


2 x M12 threaded rod with fischer FIS V or equivalent, 70 mm min embedment into masonry core, fully grouted 20 MPa uncracked concrete, ensure 55 mm min. side edge distance.

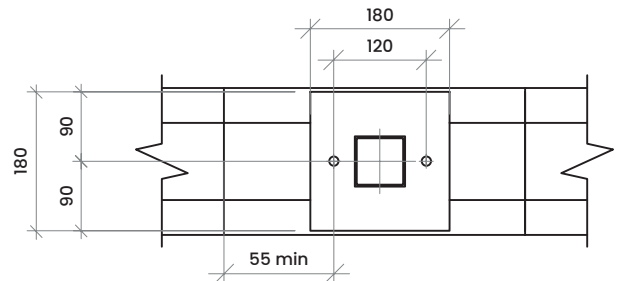

## Post Details for Balustrade – Commercial and Residential

| Zone Class   | Loading  | Panels             | Posts   | Fasteners  |
|--|----------|--------------------|---|--|
| B, E, C3<br>Parks, Schools, Multi- Dwelling<br>Residential, Commercial | 0.75kN/m | Mercury Commercial | 65shs x 2.5mm Steel<br>10mm thick flange<br>Post centers varies | <500m from sea - 304SS,<br>>500m from sea - 304SS or HDG |

## Top Fix to Timber Deck - Residential

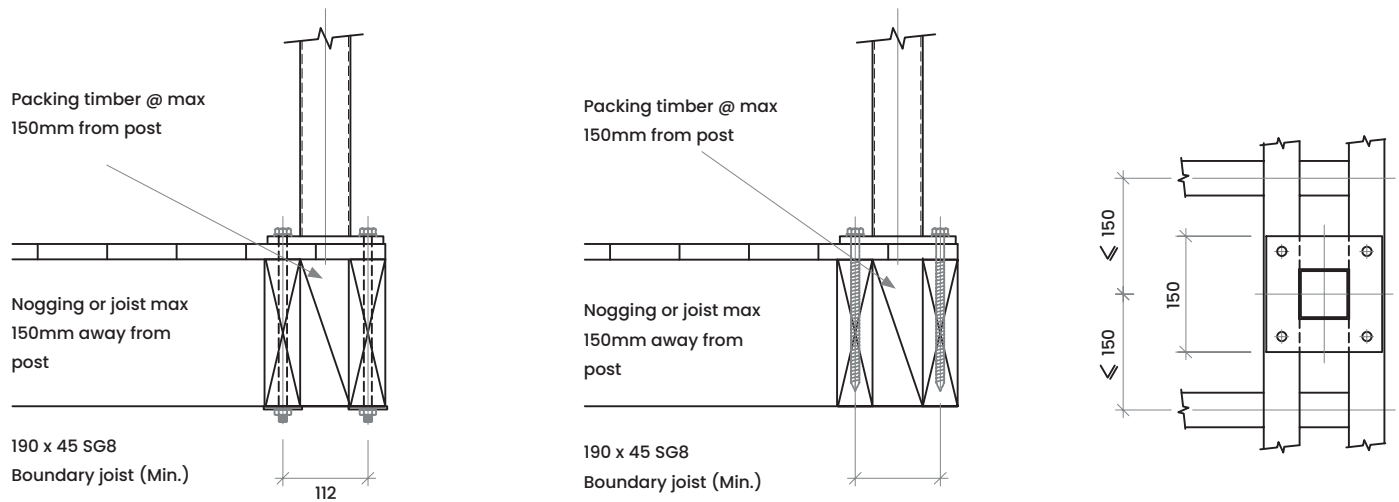

### Fixings: Bolts

4 x M10 Bolts (min.) with 50 x 50 x 3mm sq washer on timber side.

Post: PF1.3x65x2.5 (Steel) or PAF1.3x65x2.5-PC (Alu)

### Fixings: Coach Screws

4 x M10 Coach Screws, min 160 mm penetration into timber.


Post: PF1.3x65x2.5 (Steel) or PAF1.3x65x2.5-PC (Alu)

## Side Fix to Timber Deck - Residential

### Fixings: Bolts

2 x M10 Bolts (min.) with 50 x 50 x 5mm or 2 x 50 x 50 x 3mm sq washer on timber side.


Deck designed by others.

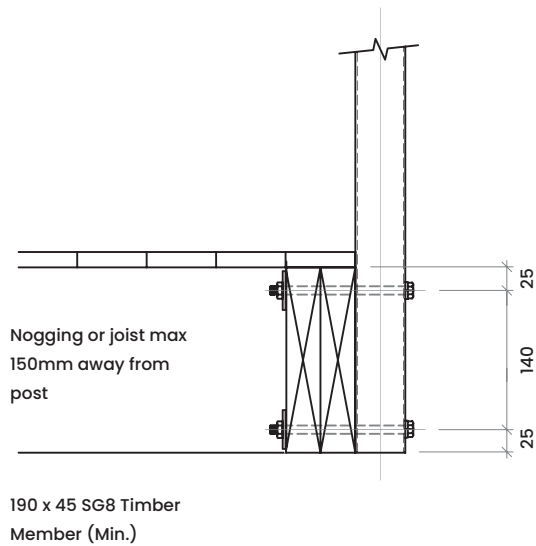

## Post Details for Balustrade - Residential

| Zone Class                       | Loading  | Panels                               | Posts  | Fasteners  |
|----------------------------------|----------|--------------------------------------|--|--|
| A<br>Single Dwelling Residential | 0.75kN/m | Mercury Commercial<br>or Residential | 665shs x 2.5mm Steel or 65shs x 2.5mm<br>6063-T5, 150 x 10mm Flange<br>Post centers 1.2m | < 500m from sea - 304SS,<br>> 500m from sea - 304SS or HDG |

## Side Fix to Timber Deck - Residential

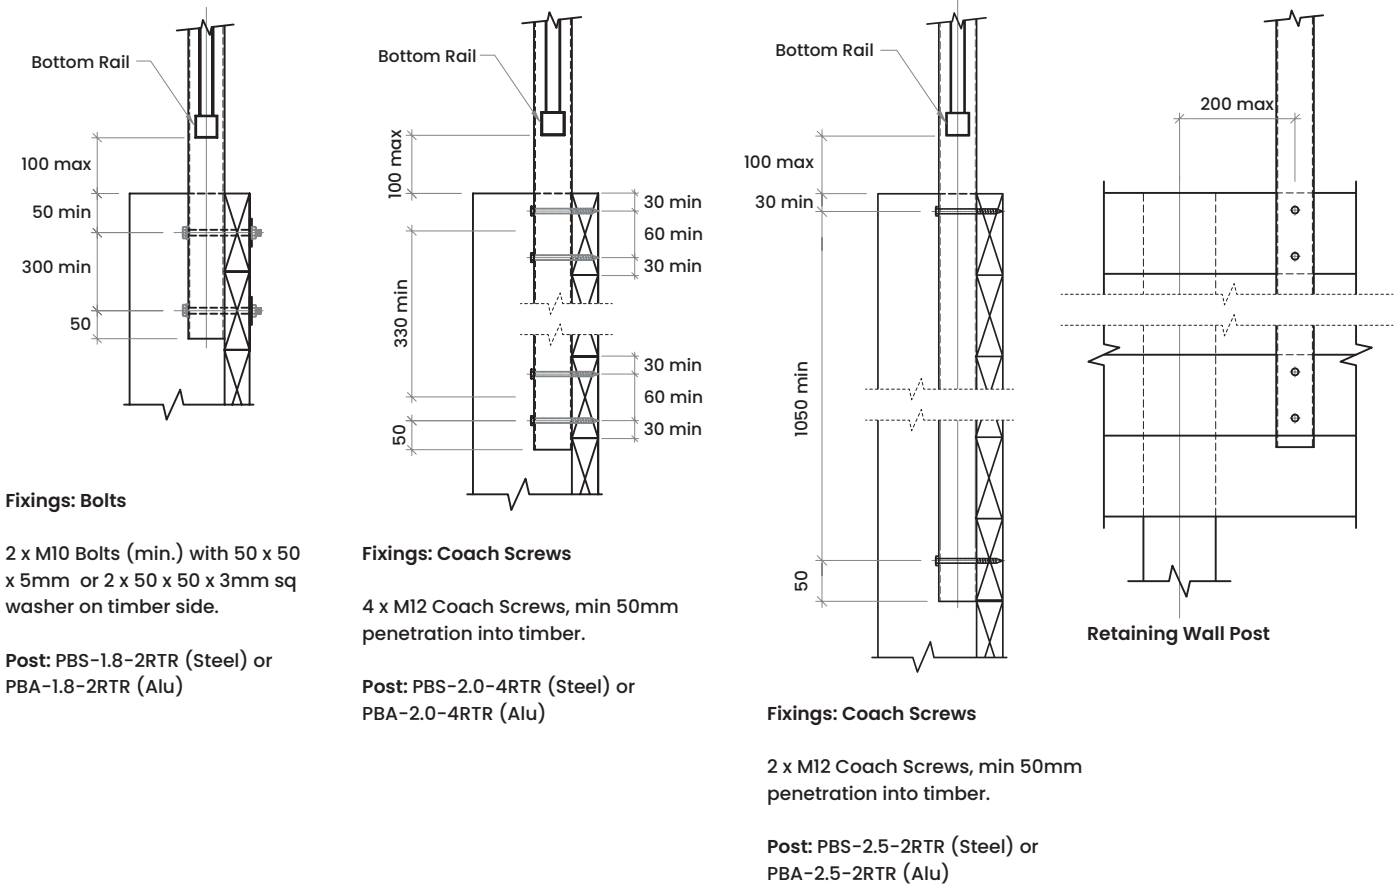


## Concreted in Ground - Residential

(drawing SK-01 S04)

**Note:**

Post footing to be embedded in good ground with min 100kPa allowable bearing as defined by NZS 3604:2001

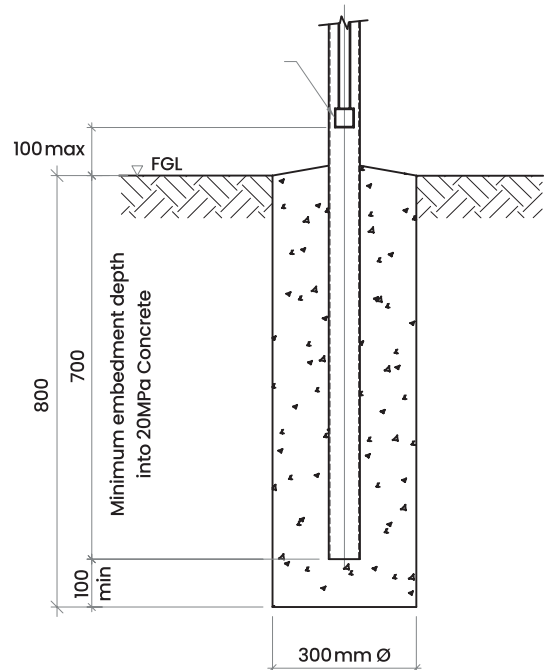

## Post Details for Balustrade - Residential

| Zone Class                       | Loading  | Panels                            | Posts   | Fasteners  |
|----------------------------------|----------|-----------------------------------|---|--|
| A<br>Single Dwelling Residential | 0.35kN/m | Mercury Commercial or Residential | 65shs x 2.5mm Steel,<br>65shs x 2.5 mm 6063-T5 Alu<br>Post centers 2.4m | <500m from sea - 304SS,<br>>500m from sea - 304SS or HDG |



---

**New Zealand Crew**

**E:** crew@edgesmith.co.nz

**Australia Crew**

**E:** crew@edgesmith.com.au

**New Zealand HQ**

20 Anvil Road, Silverdale  
Auckland 0932

**P:** 09 427 4980

**Australia HQ**

Unit 6/49 Bertie St,  
Port Melbourne VIC 3207

**P:** 0456 314 652

**East Tamaki Branch**

20 Kerwyn Avenue, East Tamaki,  
Auckland 2013

**P:** 09 777 7268

**Brisbane Branch**

55-57 Kabi Circuit, Deception Bay,  
Queensland 4508

**P:** 07 3707 6450

**Christchurch Branch**

4 Anchorage Road, Hornby South,  
Christchurch 8042

**P:** 03 662 9040

---